



## Heat meter Q heat 5.5 US comp.

STATIC ULTRASONIC HEAT- / COLDMETER

- › Ultrasonic measurement - precise and durable
- › Flow and return of the device can be parameterised on site
- › Intelligent, adaptive measuring cycle
- › Any installation possible without any restrictions
- › Measuring accuracy class 2
- › Available as heat meter, as heat meter with optional cooling range and as nationally approved cooling meter
- › Q<sub>p</sub> 0,6 - 2,5 m<sup>3</sup>/h available
- › Integrated radio communication interfaces, M-Bus and Impuls-out

## Application

Remote meter reading can be either stationary or mobile, as the devices transmit the data telegrams including 13 monthly values in a short transmission interval. The mobile readout takes place via Q log and ACT46. The stationary readout is carried out exclusively via Q gateway 5.5 direct and Q SMP. This means that a change to stationary readouts can be made at any time without reconfiguration.

## Accoutrement

The products are equipped with a QUNDIS-specific data matrix code. The code is located on the top of the meter, on the packaging and on the outer packaging and contains the serial number, the complete article number, the year of conformity assessment and the number of products.


## Technical data

General	
Measuring accuracy	Class 2 (EN 1434)
Environment class	A (EN 1434) for indoor installation
Mechanical class	M1 *)
Electromagnetic class	E1 *)
Ambient humidity	< 93 % relative humidity at 25 °C, without condensation
Max. height	2000 m above sea level
Storage temperature	-20 ... 60 °C
*) acc. to 2014/32/EU Directive on Measuring Instruments	
Electronic unit	
Ambient temperature	5 ... 55 °C
Housing protection rating	IP 54 acc. to EN 60529
Power supply	Battery for 6 or 11 years
Operation threshold for $\Delta T$	0,2 K
Temperature difference $\Delta T$	3 K ... 80 K
Temperature measurement range	0 ... 180 °C
Measuring cycle (Adaptive)	<p><b>Temperature measurement:</b> Every 60 seconds, temporarily 4 seconds with fast change of volume flow rat</p> <p><b>Volume measurement:</b> Every 4 seconds</p>
LCD	
LCD	7 digit
Optical interface	Standard, EN 62056-21
Communication	Optional
Removable electronic unit	Standard, cable length 1.5 m
Temperature sensor	
Type	Pt500 acc. to EN 60751, not detachable
Connection type	Pt500, 2 wire technology
Cable length	1.5 m (optional 5 m)
Construction type	Bulb sensor $\varnothing$ 5.2 × 45 mm
Temperature range	0 ... 95 °C

## Technical data

Volume measurement unit				
Protection class	IP 65 according to EN 60529			
Mounting place	supply flow (standard) return flow (parameterizable on site)			
Installation position	Any			
Flow straightening	None			
Measuring range	1:100			
Temperature range	5 ... 90 °C			
Maximum overload	$q_s = 2 \times q_p$ , permanent			
Nominal pressure	PN16 (1.6 MPa; PS16)			
Nominal flowrate $q_p$	0.6	1.5	2.5	[m <sup>3</sup> /h]
Overall length	110	110	130	[mm]
Connection	G $\frac{3}{4}$	G $\frac{3}{4}$	G1	G/DN
Maximum flowrate $q_s$	1.2	3	5	[m <sup>3</sup> /h]
Minimum flowrate $q_i$	6	15	25	[l/h]
Response threshold (variable)	1.2	3	5	[l/h]
Pressure loss at $q_p$	75	135	135	[mbar]
Kv-value at $\Delta p$ 1 bar	2.2	4.1	6.8	[m <sup>3</sup> /h]
Kv-value at $\Delta p$ 100 mbar	0.7	1.3	2.2	m <sup>3</sup> /h
Weight	520	520	560	[g]

Pressure loss diagram

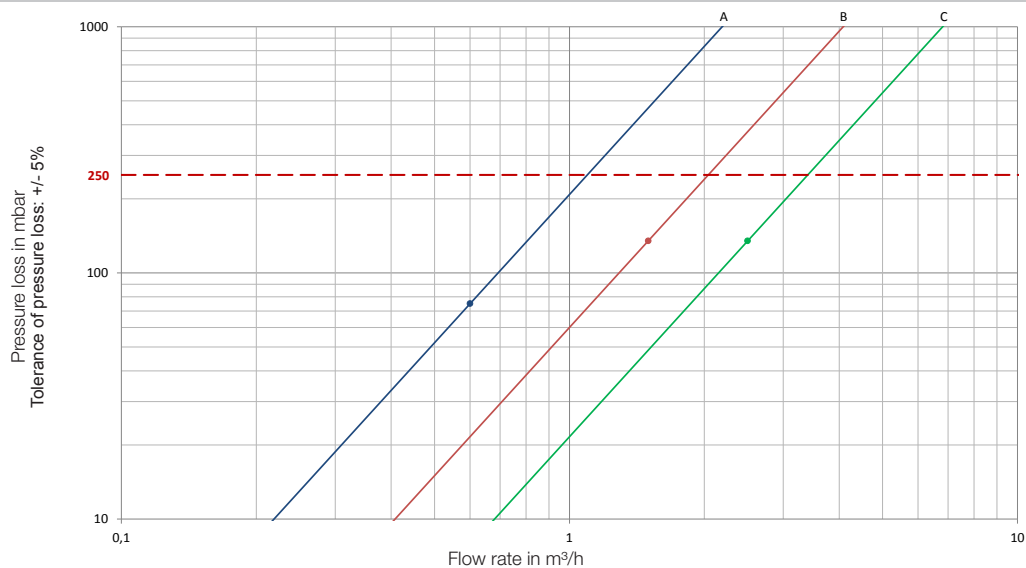

## Technical data

Dimensions ( $q_p$  0,6 – 2,5 m<sup>3</sup>/h)

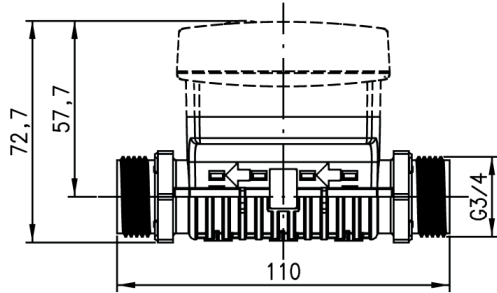


Fig. 1: Overview dimensions overall length 110 mm

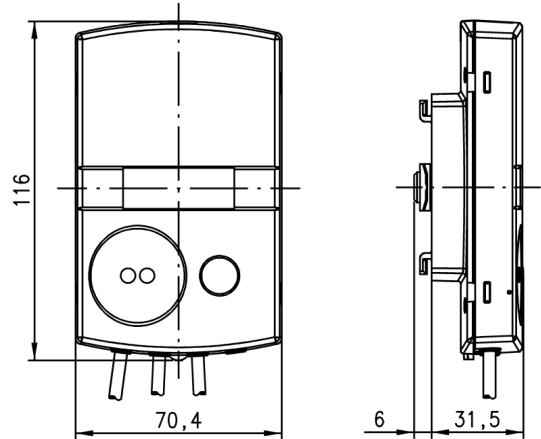


Fig. 3: Dimensions of electronic unit

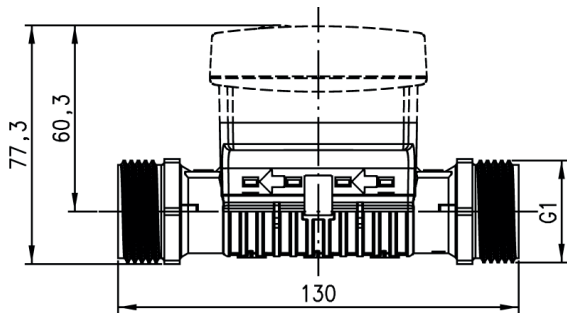


Fig. 2: Overview dimensions overall length 130 mm

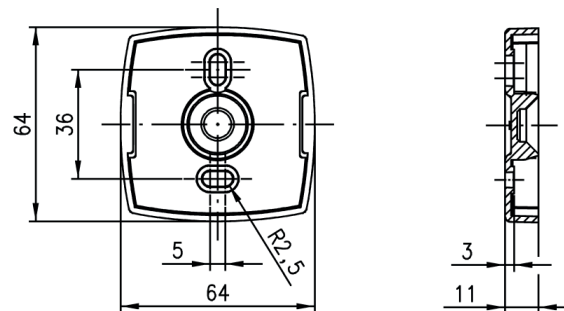


Fig. 4: Wall adapter (view from above and side)

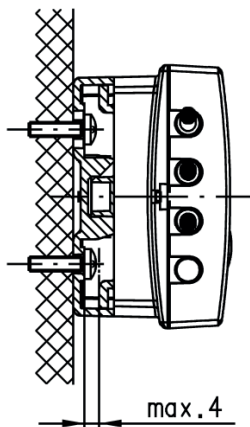


Fig. 5: Maximum screw head height (if using the wall bracket)

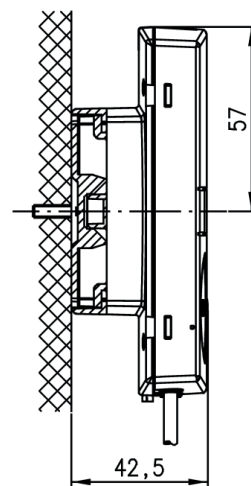



Fig. 6: Wall mounting

## Communication (optional)

wM-Bus *)			
Versions	<ul style="list-style-type: none"> <li>• exclusively as heat meter</li> <li>• exclusively as cooling meter</li> </ul>		
Standard	Open Metering System Specification OMS (Issue 4.0.2) EN 13757-4; Modus C1		
Transmission frequency	868,95 MHz		
Transmitting power	Typical 10 dBm		
Transmission interval	Predefined ex works and optimized for integration into the Q log and the Q gateway 5.5 direct, 120 seconds, 24 hours a day, 365 days a year		
Data telegram	Predefined ex works and optimized for integration into Q log and Q gateway 5.5 direct		
Data telegram content	<table border="0"> <tr> <td> <ul style="list-style-type: none"> <li>• Current energy quantity</li> <li>• Key date</li> <li>• Key date value</li> <li>• Date of last end of month</li> </ul> </td> <td> <ul style="list-style-type: none"> <li>• Value at last end of month</li> <li>• Time without measuring function</li> <li>• Current date/time</li> <li>• 13 monthly values</li> </ul> </td> </tr> </table>	<ul style="list-style-type: none"> <li>• Current energy quantity</li> <li>• Key date</li> <li>• Key date value</li> <li>• Date of last end of month</li> </ul>	<ul style="list-style-type: none"> <li>• Value at last end of month</li> <li>• Time without measuring function</li> <li>• Current date/time</li> <li>• 13 monthly values</li> </ul>
<ul style="list-style-type: none"> <li>• Current energy quantity</li> <li>• Key date</li> <li>• Key date value</li> <li>• Date of last end of month</li> </ul>	<ul style="list-style-type: none"> <li>• Value at last end of month</li> <li>• Time without measuring function</li> <li>• Current date/time</li> <li>• 13 monthly values</li> </ul>		
Start of radio telegrams	<ul style="list-style-type: none"> <li>• Automatically after a cumulative volume of approx. 10 L</li> <li>• Alternatively via operating button on the device or via software</li> </ul>		
M-Bus			
Versions	<ul style="list-style-type: none"> <li>• exclusively as heat meter</li> <li>• exclusively as cooling meter</li> <li>• as heat meter with optional cold range (outside the measuring instrument directive)</li> </ul>		
Standard	EN13757-2 / EN13757-3		
Address	Primary- or secondary address		
Transmission rate	Autobaud: 300 / 2400 Baud		
Connection	1.5 m cable, 2-wired, fixed		
Reading interval	> 1 min @ 2400 baud		
Data telegram	1 predefined data telegram ex works; User-defined telegrams configurable with software		
Previous month values	24 prev. month telegram via roll frame function available; 24 prev. monthly values available in user defined telegram		
Pulse output			
Versions	<ul style="list-style-type: none"> <li>• exclusively as heat meter</li> <li>• exclusively as cooling meter</li> <li>• as heat meter with optional cold range (outside the measuring instrument directive)</li> </ul>		
Output type	open drain		
Classification	OB/OC (according to EN 1434-2)		
Cable	1.5 m; 4-wired, LL84201 4xAWG28 / 0.2 mm <sup>2</sup>		
Cable diameter	4 mm		
Cable labelling	passive pulse output		
Voltage	max. 30 V		
Current	max. 30 mA		
Dielectric strength	500 V <sub>eff</sub> against ground		
ON/OFF resistance	100 Ω / 6 MΩ		
Output connection			

\*) The devices with integrated radio communication are optimized with regard to their transmission interval and telegram content. They are intended exclusively for reception by the Q gateway 5.5 direct, the Q SMP and the Q log and the ACT46. Changes to the factory-configured telegram content and transmission interval can lead to malfunctions.

---

✉ **QUNDIS GmbH**

Sonnentor 2  
99098 Erfurt

☎ +49 (0) 361 26 280-0

☎ +49 (0) 361 26 280-175

✉ info@qundis.com

**www.qundis.com**

The information in this data sheet only contains general descriptions or product characteristics, which may not always apply in particular application cases and/or may be subject to change through further development of the product. Required product characteristics are then binding if they are expressly agreed when the contract is drawn up.  
©2019 QUNDIS GmbH. Subject to change